


GENERAL MECHANICAL DEMOLITION NOTES:

1. DISCONNECT AND REMOVE ALL PREVIOUSLY ABANDONED PIPING AND DUCTWORK. REMOVE EXISTING/ABANDONED HANGERS AND SUPPORTS IF DEEMED NOT REUSABLE.
2. ALL PIPING AND DUCTWORK SHOWN IS BASED ON ORIGINAL DRAWINGS AND FIELD VERIFICATION OF MAINS. THE CONTRACTOR SHALL BE RESPONSIBLE TO DETERMINE ROUTE AND TO VERIFY ALL EXISTING CONDITIONS OF BRANCH PIPING AND DUCTWORK. ALL DEMOLISHED PIPING AND DUCTWORK SHALL BE REMOVED AND DISPOSED OF BY THE CONTRACTOR.
3. ALL PIPING AND DUCTWORK ASSOCIATED WITH EXISTING SYSTEMS TO BE REMOVED SHALL BE DEMOLISHED. NO PIPING OR DUCTWORK SHALL BE ABANDONED.
4. CONTRACTOR SHALL BE RESPONSIBLE FOR DRAINING PIPING SYSTEMS TO BE CUT, CAPPED, OR REMOVED. DISCHARGE FROM SUCH SYSTEMS SHALL BE APPROPRIATELY DISPOSED PER FEDERAL, STATE AND LOCAL REQUIREMENTS.
5. CONTRACTOR SHALL REMOVE ALL EXISTING AND/OR ORIGINAL CONTROLS. COORDINATE WITH CONTROLS VENDOR.
6. THE CONTRACTOR SHALL COORDINATE WITH AN OWNER PROVIDED LIST OF ANY EQUIPMENT THE MAINTENANCE DEPARTMENT MAY WISH TO RETAIN AFTER REMOVAL. THE CONTRACTOR SHALL BE RESPONSIBLE TO DISPOSE OF ALL REMOVED AND/OR DEMOLISHED EQUIPMENT THE OWNER CHOOSES NOT TO RETAIN.
7. (48) FORTY-EIGHT HOUR WRITTEN NOTICE SHALL BE GIVEN TO THE OWNER PRIOR TO DISRUPTION OF UTILITIES OR SERVICES TO OR WITHIN THE BUILDING. SUBJECT TO THE OWNER'S APPROVAL. SEE SPECIFICATION SECTION 01 00 00 GENERAL REQUIREMENTS.
8. CONTRACTOR IS RESPONSIBLE TO VERIFY ACTUAL NUMBER & LOCATION OF SYSTEMS AND COMPONENTS TO BE DEMOLISHED AND REMOVED.
9. OWNER SHALL REMOVE ALL EXISTING CONTROL ITEMS (PANELS, CONTROLLERS, ACTUATORS, ETC.) PRIOR TO THE START OF DEMOLITION. CONTRACTOR SHALL COORDINATE WITH OWNER.

KEYED MECHANICAL DEMOLITION NOTES:

- 1 REMOVE EXISTING SUPPLY REGISTER AND ASSOCIATED DUCTWORK.
- 2 REMOVE EXISTING EXHAUST GRILLE AND ASSOCIATED DUCTWORK.
- 3 REMOVE EXISTING EXHAUST DUCT UP TO ROOF MOUNTED EXHAUST FAN, REMOVE FAN.
- 4 REMOVE EXISTING SUPPLY DUCT.
- 5 REMOVE EXISTING DUCT MOUNTED REHEAT COIL AND ASSOCIATED DUCTWORK, PIPING AND CONTROLS.
- 6 REMOVE EXISTING HEATING HOT WATER PIPING.

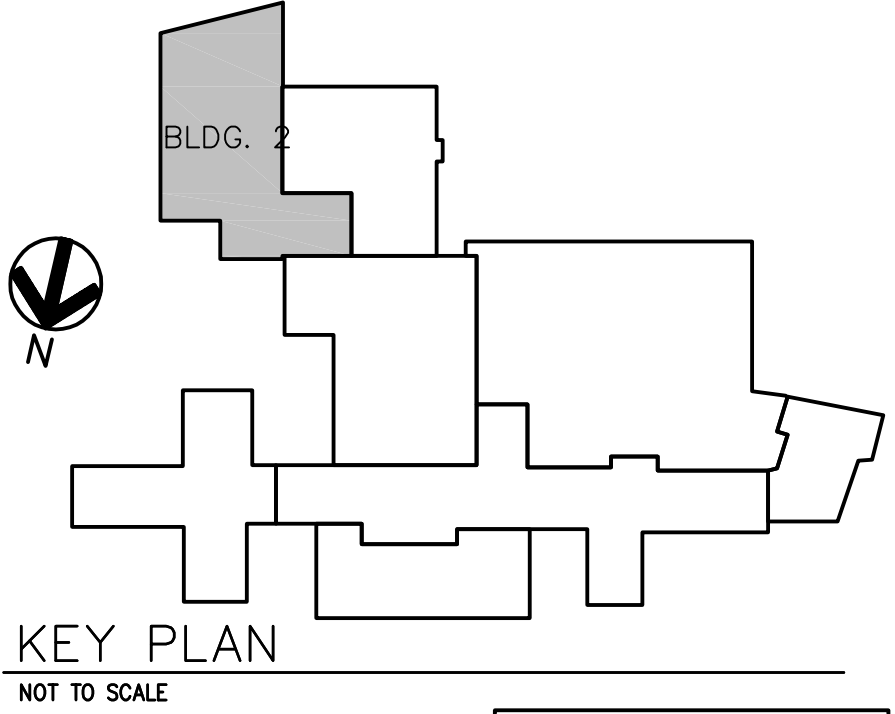

2-2

			<div>SHIVEHATTERY</div> <div>ARCHITECTURE+ENGINEERING</div> <div>2834 Northgate Drive Iowa City, Iowa 52245</div> <div>319.354.3040 fax: 319.354.6921 shive-hattery.com</div> <div>Iowa Illinois Missouri</div>	Drawing Title		Project Title		Date 12-05-2014			
				SECOND FLOOR MECHANICAL DEMOLITION PLAN		RENOVATE AND EXPAND SPACE FOR PATIENT SUPPORT AREAS		CONSTRUCTION DOCUMENTS			
				Approved: Division Chief		Building Number 2		Checked TRF		Drawn MSJ	
				Approved: Service Director		Location IOWA CITY VA HEALTH CARE SYSTEM IOWA CITY, IOWA		Project No. DVA#636-311 S-H#110240-0		DRAWING NO. 2-HD2	
										Dwg. 12 Of 24	
Revisions	Date									Veterans Administration	

Veterans Administration